- All units are in millimetres - Tested according EN 1366-3

- Classification Report 23003B

INFORMATION:

- Not to scale

Cables Through Slab

APPLICATION:

CP638: MP-RF-E-01

CP 638 Mortar


02


ID:

DATE: 05/2025

Fire Rating up to El 180

Page 1/1

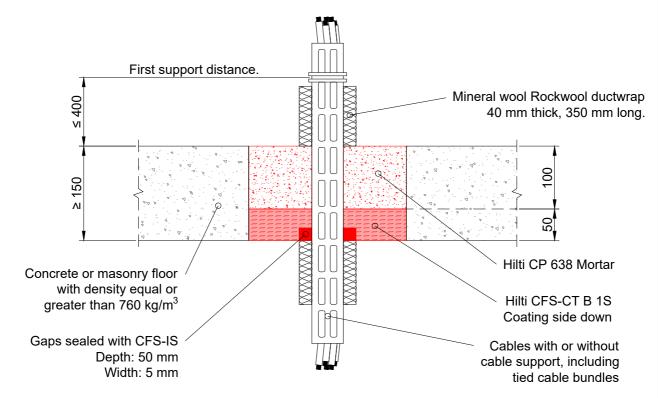



Cable description	Classification
Single cables max Ø 21 mm	EI 180
Cables bundles ≤ Ø 100 mm, max. cable ≤ Ø 21 mm	EI 180
Non-sheathed cables ≤ Ø 24 mm	EI 180
Coaxial cables ≤ Ø 28 mm	EI 120
Cables with 22 ≤ Ø ≤ 80 mm	EI 120

For Mixed Seals the above Classifications are capped at EI 120

Maximum opening size without additional support: 2000 x 1800 mm or reduced width, with up-to 10m length. See classification report for further details.

Description	Shortcut	Distance
Cable/cable carrier and aperture edge aside	b ₁₋₁	0 mm
Cable/cable carrier and aperture edge above	b ₁₋₂	0 mm
Cable/cable carrier and aperture edge below	b ₁₋₃	0 mm
Cable/cable carrier and other cables/cable carriers in linear arrangement	C ₁	0 mm
Cable/cable carrier and other cables/cable carriers bellow	C ₂	50 mm
To other pipes sealed with CFS-B	c ₃	0 mm
To metal trunking	C ₄	25 mm
To other pipes sealed with CFS-S ACR	C ₅	0 mm
To other pipes sealed with CFS-C EL	c ₆	0 mm
To any other services	c ₇	100 mm

^{1.} The application limits on this detail are for guidance purposes only. For more detailed information based on the full range of available test results please contact the Hilti Technical Advisory Service.

2. The product and application has been assessed as a minimum to the BS 476 standard. It may have additional European and worldwide testing. Please contact Hilti for further information.

3. All installations should be carried out in accordance with Hilti's installation installa